
The economics of rainwater tanks and alternative water supply options

*A report prepared for Australian Conservation Foundation,
Nature Conservation Council (NSW) and Environment Victoria*

April 2007

Marsden Jacob
A s s o c i a t e s

<http://www.marsdenjacob.com.au>

Marsden Jacob Associates

Financial & Economic Consultants

ABN 66 663 324 657

ACN 072 233 204

Internet: <http://www.marsdenjacob.com.au>

E-mail: economists@marsdenjacob.com.au

Melbourne office:

Postal address: Level 3, 683 Burke Road, Camberwell

Victoria 3124 AUSTRALIA

Telephone: +61 (0) 3 9882 1600

Facsimile: +61 (0) 3 9882 1300

Brisbane office:

Level 5, 100 Eagle St, Brisbane

Queensland, 4000 AUSTRALIA

Telephone: +61 (0) 7 3229 7701

Facsimile: +61 (0) 7 3229 7944

Author(s): Phil Pickering, Kym Whiteoak

This paper can be cited as: MJA, 2007. *The economics of rainwater tanks and alternative water supply options*. Prepared for the Australian Conservation Foundation, Nature Conservation Council (NSW) and Environment Victoria. April 2007.

This report has been prepared in accordance with the scope of services described in the contract or agreement between Marsden Jacob Associates Pty Ltd ACN 072 233 204 (MJA) and the Client. Any findings, conclusions or recommendations only apply to the aforementioned circumstances and no greater reliance should be assumed or drawn by the Client. Furthermore, the report has been prepared solely for use by the Client and Marsden Jacob Associates accepts no responsibility for its use by other parties.



Copyright © Marsden Jacob Associates Pty Ltd 2007

TABLE OF CONTENTS

	Page
Executive Summary	4
1. Introduction.....	8
2. The relative cost of rainwater tanks	9
2.1. Rainwater tank yields	9
2.2. Cost of rainwater tanks.....	11
2.2.1. Rainwater tank costs	12
2.3. Cost of alternative water sources	12
2.3.1. Case Studies: Sydney and SEQ.....	14
2.3.2. Summary	15
2.4. Other potential impacts.....	16
2.4.1. Water mains	16
2.4.2. Stormwater systems	17
3. Adding environmental costs to levelised costs	19
3.1. The cost of carbon	20
4. Deferring alternative water sources with rainwater tanks	22
5. Cost of rolling out rainwater tanks	31
6. References	33

Executive Summary

Marsden Jacob Associates (MJA) has been commissioned by the Nature Conservation Council of NSW, Environment Victoria and the Australian Conservation Foundation to conduct research into the impact of a targeted rainwater tank roll-out in Sydney, Melbourne and South East Queensland (SEQ).

For individual property owners, the cost effectiveness of rainwater tanks is typically determined by comparing the cost of installing and operating a rainwater tank against savings from household water bills plus the impact of garden water restrictions. However, considering the benefits only from the perspective of the property owner does not recognise the broader cost savings to the community such as deferred water infrastructure, savings to stormwater infrastructure, and environmental externalities such as the cost of greenhouse gas emissions.

The present study compares the yield and levelised cost (i.e. the cost per kilolitre supplied) of various long term water source options in Sydney, Melbourne and SEQ against the potential yield and cost of rainwater tanks. Previous research by MJA for the National Water Commission indicates that both the yield and the cost of tanks varies significantly based on individual household variables – in particular the size of the roof collection area.

This study compares the cost of rainwater tanks with other water infrastructure such as dams and desalination plants. Levelised cost (the cost per kilolitre of water supplied) is a factor of water yield from a particular technology and the cost of supplying it. Yield from a 5 kilolitre tank for a small (50m²) and large (200m²) roof collection area was shown to vary from around 47 kL to 105 kL in Sydney, 24 kL to 86 kL in Melbourne and 41 kL to 99 kL per year in Brisbane (airport sites only).

Table 1 summarises the potential annual yield and levelised cost of rainwater tanks and other alternative water sources. The levelised costs in Table 1 are provided to illustrate the relative cost of each option under specific conditions, however caution must be applied in comparing results because:

- levelised cost indicates the direct cost of each option only and does not account for social, environmental or “flow-on” economic impacts;
- levelised cost assumes that water sources will be utilised at their maximum capacity from the first day of commissioning. In practice, many options may be underutilised in early years, resulting in a higher unit cost;
- different options have different levels of water supply reliability and may not be appropriate for all purposes (such as emergency drought situations). Ideally, a full portfolio analysis should incorporate an analysis of the relative supply risks of each water supply option.

Table 1: Levelised cost of alternative sources – Sydney and SEQ

Water Source	Total annual yield (GL/a)	Levelised cost (\$/kl)
<i>Sydney</i>		
Rainwater tank (additional 10% take up) ¹	8-17	2.15-5.41
Rainwater tank (additional 65% take up) ¹	49-110	2.15-5.41+
Desalination (125 ML/day)	up to 46	2.70-3.50
Desalination (500 ML/day)	up to 182	1.80
<i>Melbourne</i>		
Rainwater tank (additional 10% take up) ¹	3-12	2.67-10.92
Rainwater tank (additional 72% take up) ¹	24-88	2.67-10.92+
Desalination	50?	Not avail.
<i>South East Queensland</i>		
Rainwater tank (additional 10% take up) ¹	5-11	2.22-6.22
Rainwater tank (additional 73% take up) ¹	33-80	2.22-6.22+
Traveston Dam	70-150	} 2.00+
Wyaralong Dam	18	
SEQ (Gold Coast) Desalination	45	
Western Corridor Recycled Water Scheme	Up to 77	

Notes:

1: Lower bound and upper bound scenarios for rainwater tank take up from additional inducement policies (see Section 4, excludes houses with an existing tank installed). Maximum take up rate may be lower due to houses with difficult or inaccessible plumbing. Based on expected yield from a “typical” 5 kL tank plumbed for both indoor and outdoor use.

In addition, the key findings of this report include:

- rainwater tanks will be widely installed in new housing developments due to regulations imposed by both the Queensland and NSW governments. While new dwellings can be designed to be ‘rainwater tank-friendly’, a growing proportion of future dwellings are expected to be in high density unit blocks which are mostly unsuitable for rainwater tanks (although the majority of new dwellings since 2001 have been detached ‘rainwater tank-friendly’ dwellings). However there is also significant potential for take-up of rainwater tanks in existing dwellings. The majority of existing dwellings, particularly in SEQ, are detached houses, making them suitable in theory for rainwater tanks. Many may not accommodate a tank due to limited land area or plumbing constraints. There are currently around 1.1 million houses potentially suitable for rainwater tanks (i.e. detached and semi-detached houses)¹ in Sydney and 0.9 million in SEQ.

¹ The ABS identifies ‘semi-detached’ houses (11% and 6.6% of total houses in Sydney and SEQ respectively in 2001) as including some row, terrace and town houses, which may be less suitable for rainwater tanks. However, MJA notes that Gold Coast City Council includes as mandatory rainwater tanks on all new

- MJA understands that it is unlikely that rainwater tanks could be installed in time, or provide sufficient security, to offset emergency water sources such as the SEQ Western Corridor Recycled Water Scheme. However, rainwater tanks can act to ‘free up’ existing water supplies and may therefore defer the need for future water sources required to cater for growth;
- in most cases, the precise timing of future water sources is unknown. In the case of Sydney, a review of the existing Metropolitan Water Plan indicates that a major new water source may not be required for 10 years or more if adequate demand management and recycling initiatives are in place. However the NSW government has indicated that a desalination plant will act as a contingency measure if water supplies fall below certain critical levels. While the exact timing of new sources is unknown, MJA has illustrated the impact of rolling out rainwater tanks to 5% of households each year, assuming that Sydney demand were 40% less than “Business As Usual” (due to demand management initiatives such as BASIX) and the SEQ demand scenario adopted by the Queensland Government. In these scenarios, expenditure in 2010 that was required to cater for demand growth across the system (excluding emergency supply options) could potentially be delayed:
 - past 2026 in Sydney or to around 2019 in SEQ if all potential housing (i.e. detached and semi-detached houses – 70 per cent of Sydney dwellings and 78 per cent of SEQ dwellings) could install a rainwater tank;
 - to around 2022 in Sydney or 2018 in SEQ if only 50% of total dwellings could install a rainwater tank;
 - to around 2012 in Sydney or 2013 in SEQ if only 10% of total dwellings could install a rainwater tank.

Water sources could potentially be deferred by more than the indicated time if demand management initiatives reduce future demand, or may be deferred by less than the time indicated due to other factors such as the need for emergency water supplies or specific regional growth requirements. The deferral of water sources will be cost effective only to the extent that rainwater tanks are less expensive than alternative water sources (refer Table 1).

Similar results would be expected for Melbourne depending on the growth in the number of dwellings and the impact of demand management initiatives.

Additional demand management initiatives could potentially defer the need for water infrastructure even further.

- for houses with large roof collection areas and average to high water use, rainwater tanks are similar in cost to other forms of water infrastructure such as dams and desalination plants (refer Table 1) in Sydney and SEQ. Dwellings with smaller roof areas typically have a low yield and therefore a significantly higher unit cost;

‘...such dwellings as stand alone single dwellings, duplexes, row houses, terrace houses, town houses and villa units’. (Gold Coast City Council, 2007: p1).

- research indicates that rainwater tanks are more than five times as energy efficient as desalination plants per kilolitre of water produced (rainwater tanks requiring around 1 MWh/ML compared with a typical desalination plant requirement of 5 MWh/ML);
- the cost of rolling out rainwater tanks to existing properties will depend on specific household attributes and will be affected by plumbing and site constraints. For many houses, internal plumbing difficulties may preclude the use of rainwater inside the house. For those existing houses that are capable of installing a tank, a “typical” 5,000 litre rainwater tank could cost in the order of \$2,500 to \$3,500 fully installed. A preliminary estimate of the cost to roll out rainwater tanks to 5% of households would therefore be approximately \$200-\$280 million per annum in Sydney, \$180-\$250 million per annum in Melbourne and \$140-\$200 million per annum in SEQ;
- as part of this exercise, the levelised cost of greenhouse gas emissions were investigated for inclusion in the levelised cost. However there is significant scope for further research in incorporating other externalities such as stormwater infrastructure savings into cost comparisons of water infrastructure. We also recognise that broader environmental and social factors must be included in comparisons of the costs and benefits of particular water infrastructure proposals.

1. Introduction

Rainwater tanks have been a familiar water supply solution in rural Australia for many years. Recently, with the impact of droughts stretching to our cities, urban Australians are now also increasingly turning to rainwater tanks as an alternative to our rapidly depleting dams.

Currently, some 17% of Australian households have installed rainwater tanks.² Rainwater tanks offer a number of advantages over conventional water sources, including:

- collectively, rainwater tanks may offer a smaller environmental footprint than dams or desalination plants;
- property owners may be able to avoid the consequences of city-wide water restrictions;
- property owners may partially offset their annual water bill;
- in some areas, rainwater may offer a better aesthetic (in particular better tasting water) than the city drinking water supply; and
- tank yield is relatively directly related to rainfall and, although day to day fluctuations may be significant, the yield over a year may be less volatile than dam supplies, which require significant rainfall to saturate catchments and begin the run-off process.

Marsden Jacob Associates has been commissioned by the Nature Conservation Council of NSW, Environment Victoria and the Australian Conservation Foundation to conduct research into the impact of targeted rainwater tank roll-out in Sydney, Melbourne and South East Queensland (SEQ). In particular, the research has been directed at four specific questions:

1. What is the cost of providing rainwater tanks (cost per kilolitre) compared to desalination plants and dams?
2. What are the additional costs and benefits of environmental externalities - in particular the impact of reducing greenhouse gas emissions and the costs of carbon abatement?
3. How many rainwater tanks would be required to avoid dams and desalination plants such as those proposed for Sydney, Melbourne and South East Queensland?
4. What would be the cost to Government of a targeted program to roll out rainwater tanks to 5% of households each year in high rainfall cities such as Sydney, Melbourne and Brisbane?

² Australian Bureau of Statistics (2006)

2. The relative cost of rainwater tanks

Question One: What is the cost of providing rainwater tanks (cost per kilolitre) compared to desalination plants and dams?

The relative cost of water supplied by rainwater tanks depends on a number of factors, including average yield from tanks, and capital and on-going costs relative to other sources. These factors vary significantly between geographical location (and therefore weather patterns) and even between particular facilities.

This section explores the elements affecting the cost of rainwater tank yield, relative to publicly available information on other water sources.

Cost efficiency of Rainwater tanks

The cost efficiency of a tank is directly related to the whole of life cost and the yield that can be drawn from the tank over time. Water from rainwater tanks can be used solely for outdoor garden use or can also be used internally. This choice has a material effect on a tank's yield and costs. For example, internal use (and in many cases garden use) typically requires the services of a plumber and the installation of a water pump, both of which are key drivers of cost.

2.1. Rainwater tank yields

Marsden Jacob Associates (MJA) recently completed a major study on the cost effectiveness of rainwater tanks for the National Water Commission, including a detailed examination of costs and annual yield. The study found that:

The yield of a rainwater tank is determined by both the volume and timing of run-off into the tank and the volume and timing of usage. The yield is therefore influenced by a number of factors, including factors specific to the individual property, including:

- *rainwater collection area (roof size);*
- *tank size;*
- *the number of occupants in the house (and therefore usage);*
- *garden requirements; and*
- *whether the tank is plumbed into the house and if so, to which areas.*

In addition, the roof run-off is also influenced by the total volume and timing of rainfall. The timing of rainfall is based on the climate conditions, which can include:


- *the heavy tropical rains of Queensland and the Northern Territory;*
- *the relatively consistent year round rainfall of New South Wales, Victoria and Tasmania; or*

- the Mediterranean climates of South West Western Australia and southern South Australia, characterised by significant rainfall during winter and relatively dry summers.

To determine the variability of tank yield, Marsden Jacob developed a model to simulate rainwater tank water balances under different conditions, known as the Multi-factor Analysis Rainwater Tank or MART model. The model determines tank yields for each city, based on rainfall at Bureau of Meteorology (BoM) sites (generally the main airport in each city). Importantly, some cities experience extensive variation in rainfall across different suburbs. Yields are therefore unlikely to be representative of the yield achievable across the entire city or area. This is particularly the case for Brisbane airport, where higher rainfall may be experienced due to its coastal location compared with other more inland suburbs.

The relative impact of the key characteristics affecting yield are shown in Figure 1.

Figure 1: Annual rainwater tank yield varied by key factors – tank plumbed for both indoor and outdoor use

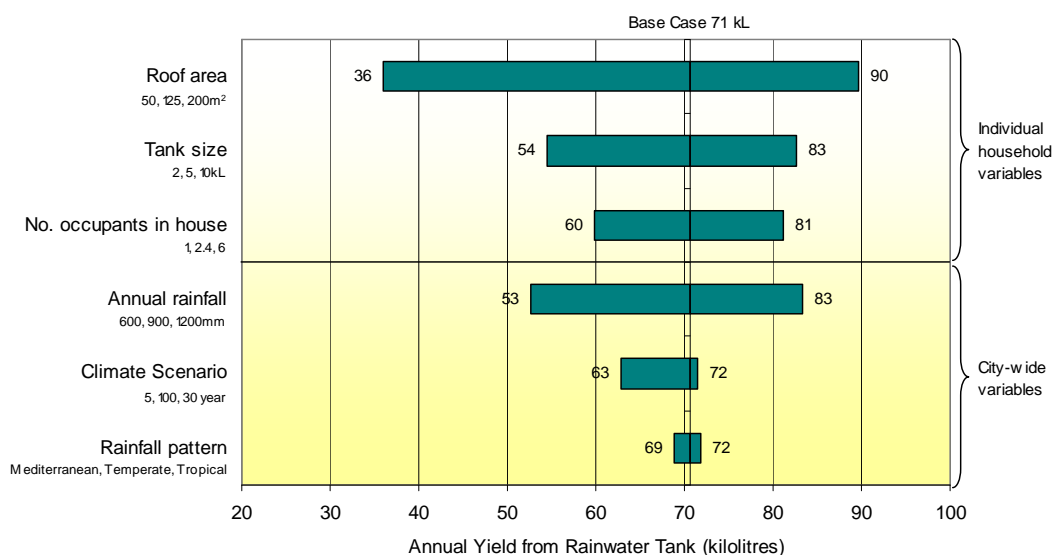

Notes: Line dissecting the graph (71 kL/year) relates to the “base case”, i.e. a property with 125m² roof connected, 5 kL tank and average 2.4 occupants, and a location with an average rainfall of 900mm (based on 100 year record) and a temperate climate. Low and high variations to yield are based on the low and high estimate described on the vertical axis.

Source: MJA MART model

MJA’s analysis shows that for rainwater tanks plumbed for both **indoor and outdoor use**:

- the “base case” will return a yield of 71 kilolitres (kL) during an average year;
- the collection area (i.e. roof size) has the single greatest impact on the total yield available from a rainwater tank, potentially varying the yield from a low of 36 kL per year to a high of 90 kL per year (assuming a 5 kL tank and all other base case assumptions);

- *the annual rainfall, tank size and number of occupants in the house (which determines indoor water use) also contribute significantly to the yield of the tank;*
- *interestingly, the climate scenario and the rainfall pattern make less difference to the tank yield than any of the other factors. The relatively small difference in tank yield under different rainfall patterns is due to the high level of indoor use. Assuming that water is not used on the garden for several days after a significant rainfall event, the tank will tend to be depleted from indoor use by the time the water is required for the garden.³*

As indicated above, the yield of a rainwater tank is sensitive to the precise rainfall for the area. Providing one representative site for rainfall for any city is a difficult task, particularly for an area the size of South East Queensland (SEQ). In modelling for rainwater tank yield, MJA has used the airport site in each case, but notes the potential for variation by suburb. For example, since 1976 the Brisbane airport site has recorded more rainfall than inland sites such as Indooroopilly (10 per cent), similar rainfall to the Bureau of Meteorology's previous regional office station (within one per cent, station located in the Brisbane central business district), and 20-30 per cent *less* rainfall than the Sunshine and Gold Coasts sites (established in 1994).⁴ MJA notes that the three major population centres in SEQ (Brisbane, the Sunshine and Gold Coasts) are all located close to the coastline.

2.2. Cost of rainwater tanks

Use of levelised cost

One method of comparing the value of different water sources is to compare levelised cost. Levelised cost estimates the cost per kilolitre of water supplies, dividing the annualised capital and operating costs by expected annual yield.

Levelised cost is a useful tool for comparing the cost of options with very different annual yields, such as small scale water tanks compared with large scale desalination. We apply levelised cost throughout this study as an indicative guide to the relative magnitude of costs, but we note that the approach is a simplification of the analysis of water supply options. Water supply planning is a complex process that needs to include consideration of environmental, social and economic factors. The economic analysis is complicated by the need to consider supply reliability objectives and to consider strategic aspects related to contingency supplies.

While some environmental factors can be quantified (such as greenhouse gas emissions – see Section 3.1), this is not always possible. Thus, levelised cost should not be used as an isolated decision-making tool.

³ Marsden Jacob (2007), pp. ES iii - v

⁴ Maroochydore Airport (30% more rainfall than Brisbane airport) and Gold Coast Seaway (20% more rainfall) between 1994 (beginning of time series) and 2006.

Due to the lack of publicly available information, another simplification required for this exercise is that the annual yield/usage from each water source will equal the maximum capacity of that source. The actual usage of large infrastructure will typically be below maximum capacity for a number of years and therefore the levelised cost may be understated in some cases depending on the actual take up rate.

A full analysis is beyond the scope of this study and therefore the levelised cost results are provided for indicative purposes only.

2.2.1. Rainwater tank costs

Research by MJA, conducted on behalf of the National Water Commission, indicates that the cost to the community of rainwater tanks with mixed indoor/outdoor use can range from \$2.15/kL to \$12.30/kL depending on the exact location, tank size and roof collection area (Table 2).

Table 2: Levelised cost of rainwater tanks to community – combined indoor and outdoor use

Tank Size Roof Area	2 kL		10 kL	
	50m ²	200m ²	50m ²	200m ²
Levelised Cost (\$/kL) ^{1,2}				
Brisbane	6.14	3.16	6.22	2.22
Sydney	5.34	2.79	5.41	2.15
Melbourne	8.75	2.98	10.92	2.67
Adelaide	9.76	3.77	12.30	3.32
Perth	7.39	3.71	8.85	3.25

Note: 1. Based on a standard above ground tank, plumbed for both indoor and outdoor use. Melbourne cost includes an offset for reduced stormwater treatment costs due to nitrogen removal in Melbourne.


2. Yield based on daily time step data from BoM sites (typically the airport). Substantial variation across cities may exist (for example, the old Brisbane regional office station shows total rainfall since 1976 to be within 1% of the total airport rainfall, however the rainfall at the Brisbane showgrounds was 10% lower for the same period).

Source: Marsden Jacob Associates (2007)

2.3. Cost of alternative water sources

The cost of alternative water sources has been estimated in planning documents produced for each Australian capital city. A summary of the available results is shown in Figure 2.

Figure 2: Direct Costs of Water Supply/Demand Options– Sydney, Adelaide, Perth, Newcastle

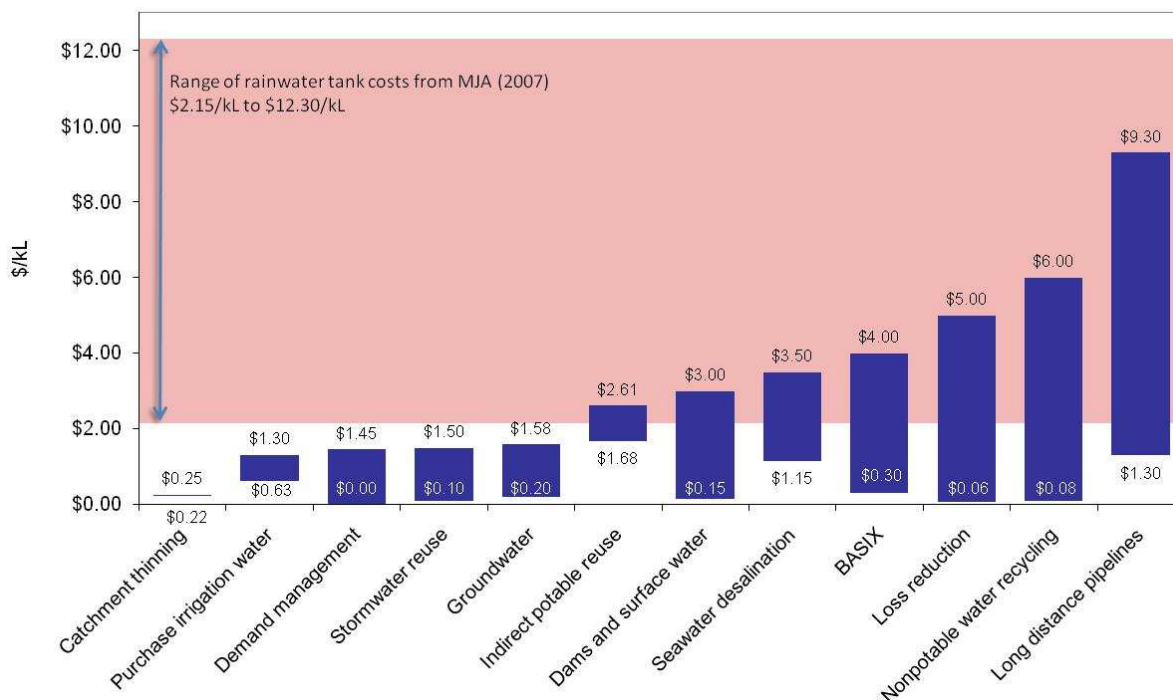

Source: MJA analysis based on water supply plans for Sydney, Adelaide, Perth, Newcastle (originally produced for MJA (2006)) and recent NSW Treasury cost estimates. Lower bound of indirect potable reuse estimate based on Toowoomba.

As indicated by the chart above, the cost of water sources varies significantly according to the specific circumstances of each city. The cost of some options, such as demand management, can be negligible in some cases, while the costs for options such as desalination, dams and recycling can potentially be as high as \$3.00/kL or more. The highest cost options include plans to pipe water significant distances for consumption by our major cities. By comparison, the unit cost of rainwater tanks that are plumbed into the house can range from \$2.15/kL to \$12.30/kL⁵. At the lower end of the range (typically reflecting the unit cost of properties with large roof collection areas), the cost of rainwater tanks is comparable to, or lower than, the cost of many water source options being examined around the country. At the higher end of the range, the cost of rainwater tanks could be as high as \$12.30/kL, significantly above the cost of most alternative water supplies.

As indicated earlier, levelised cost is a useful tool for comparing the cost of different water sources, however a full assessment of the benefits of any particular water source should take into account all of the social, environmental and economic factors, including the relative reliability of each source.

In addition to the benefit of deferring new water sources, rainwater tanks may also allow a reduction in the size of water mains or stormwater infrastructure costs. However significant

⁵ Cost is lower if the tank does not require a water pump. See Marsden Jacob (2007) for more information.

savings will typically only be achievable in a greenfield environment, i.e. prior to the construction of the water and stormwater infrastructure. If the stormwater infrastructure savings indicated in research by Coombes and Kuzcera (2003) are achievable in other areas, then the levelised cost of rainwater tanks could potentially be offset by stormwater savings in the order of \$0.30/kL to \$1.00/kL. (For a more detailed discussion of the potential for stormwater savings see MJA (2007)).

2.3.1. Case Studies: Sydney and SEQ

Below we examine the major water supply options for two specific case studies – Sydney and South East Queensland.

Sydney: One of the major water supply options for Sydney is a desalination plant of between 125 ML per day and 500 ML per day capacity. The capital expenditure of the full scale (500 ML per day) desalination plant and associated infrastructure has been estimated to be in the order of \$2.5 billion, with operating expenditure of \$165 million per year,⁶ while a 125 ML per day option would cost \$1.3 - \$1.9 billion⁷. These estimates indicate a levelised cost of around \$1.80/kL for the largest plant (assuming that it is used at maximum capacity) and \$2.70 - \$3.50/kL for the smaller plant (assuming the same operating cost per kilolitre as the larger plant).

Queensland: A number of options are available to increase the water supply to South East Queensland, including desalination, the Western Corridor Recycled Water Scheme and dams at Traveston Crossing and Wyaralong. Full financial details have not yet been released by the Queensland Government, however estimates provided by the Department of Natural Resources, Mines and Water (DNRMW) show the following estimates of capital cost:

	Prudent Yield (GL)	Capital Cost (\$m)
Traveston Dam Stage 1	70	1,400 to 1,700
Traveston Dam Stage 1 plus Borumba	110	1,650 to 1,950
Traveston Stages 1 and 2 (incl Borumba)	150	2,000 to 2,500
Wyaralong Dam	18	500
SEQ (Gold Coast) Desalination	45	850
Western Corridor Recycled Water Scheme:		
Stage 1	30	641
Stage 2 (includes Stage 1)	Up to 77	1,784

Source: DNRMW, *Water for South East Queensland: A long term solution*

⁶ Sydney Water fact sheet, *Indirect potable recycling and desalination - a cost comparison*

⁷ \$1.3 billion based on previous Sydney Water estimates. \$1.9 billion based on NSW Treasury costing estimates that allow for a 125 ML/d plant that “could be quickly scaled up to 500 million litres a day if necessary”. www.treasury.nsw.gov.au/promises/pdf/cost_42.pdf

Other information required for a levelised cost calculation, including operating costs and interconnection costs, have not yet been publicly released. Due to siting constraints, it is expected that the cost of connecting both desalination plants and dams into the proposed SEQ “water grid” will add significantly to both the capital and operating cost of supply.

In addition, MJA understand that cost and yield estimates are currently being refined by the Queensland Government. Therefore any attempt to estimate the levelised cost with precision could be misleading before final estimates are released.

MJA has therefore not attempted to quantify levelised costs particular to SEQ, but we note that costs for comparable desalination plants and dams are at least \$2.00/kL, and will potentially be significantly higher in SEQ due to the substantial siting constraints. This estimate is provided for order of magnitude comparison only and MJA recommend that a site specific analysis is conducted once more detailed cost information is released.

2.3.2. Summary

Table 3 summarises the comparative levelised costs of alternative water sources for Sydney and South East Queensland, including rainwater tanks. As can be seen, the levelised cost per kilolitre of some rainwater tanks will, *prima facie*, be cost competitive against desalination and the South East Queensland dams. Rainwater tanks with higher unit costs, typically those associated with small roof collection areas, will not be cost competitive against alternative water sources.

Estimates are provided for indicative purposes only. As noted earlier, caution should be applied when comparing these estimates, as costs do not include externalities such as the impact on stormwater systems, avoided environmental costs of inundation for dams and greenhouse gas emissions (see Section 3.1 for inclusion of greenhouse abatement costs).⁸ In addition, a full assessment of the relative cost of each water source would require a careful review of the relative reliability of dams, desalination plants and rainwater tanks to establish the degree to which each provided a secure long term source of water. We note that dams and rainwater tanks each have features that promote different aspects of reliability – for example, while dams can smooth out rainfall variability over a number of years (due to their significant capacity), rainwater tanks are less dramatically impacted by extended or severe droughts (tanks have a relatively direct relationship to rainfall, while dam catchments require significant initial rainfall to begin the run-off process). See MJA (2007) for a more detailed discussion on the relative reliability of dams compared with rainwater tanks.

⁸ It should be noted that Sydney Water has announced that all energy costs associated with a desalination plant will be ‘carbon neutral’, presumably through an exclusive arrangement with a renewable energy supplier.

Table 3: Levelised cost of alternative sources – Sydney and SEQ

Water Source	Total annual yield (GL/a)	Levelised cost (\$/kl)
<i>Sydney</i>		
Rainwater tank (additional 10% take up) ¹	8-17	2.15-5.41
Rainwater tank (additional 65% take up) ¹	49-110	2.15-5.41+
Desalination (125 ML/day)	up to 46	2.70-3.50
Desalination (500 ML/day)	up to 182	1.80
<i>Melbourne</i>		
Rainwater tank (additional 10% take up) ¹	3-12	2.67-10.92
Rainwater tank (additional 72% take up) ¹	24-88	2.67-10.92+
Desalination	50?	Not avail.
<i>South East Queensland</i>		
Rainwater tank (additional 10% take up) ¹	5-11	2.22-6.22
Rainwater tank (additional 73% take up) ¹	33-80	2.22-6.22+
Traveston Dam	70-150	} 2.00+
Wyaralong Dam	18	
SEQ (Gold Coast) Desalination	45	
Western Corridor Recycled Water Scheme	Up to 77	

Notes:

1: Lower bound and upper bound scenarios for rainwater tank take up from additional inducement policies (see Section 4, excludes houses with an existing tank installed). Maximum take up rate may be lower due to houses with difficult or inaccessible plumbing. Based on expected yield from a “typical” 5 kL tank plumbed for both indoor and outdoor use.

2.4. Other potential impacts

Two key additional areas for indirect cost savings are local water mains and stormwater infrastructure.

2.4.1. Water mains

In greenfield sites there is some potential to reduce the size of water mains if rainwater tanks are widely installed and will be used during peak water usage periods. Smaller mains are often sized to meet minimum fire-fighting requirements, however augmentation of larger distribution and trunk mains could potentially be deferred or avoided if peak water usage is reduced through the installation of rainwater tanks. There has been little work done on the impact of rainwater tanks on peak water usage, however it is likely that peak usage will occur at times of high garden watering, when rainfall is lowest. If rainfall is low, then it is likely that rainwater tanks will also be drawn down at times of peak usage.

Furthermore, the reduction in the cost of water mains is not proportional to the reduction in peak usage because of significant fixed costs associated with water mains. The impact of rainwater tanks on the size of local water mains will be limited, however the potential for cost savings should be considered on a case by case basis.

2.4.2. Stormwater systems

There have also been few studies on the impact of reduced demand on the size of stormwater infrastructure. The capital cost of established sites will be unlikely to change if rainwater tanks are introduced (some replacement costs may be reduced but stormwater assets are mostly long-lived). MJA (2007) noted that:

For greenfield sites or established areas requiring augmentation of infrastructure, the size of stormwater infrastructure might be reduced if run-off from roofs is diverted by rainwater tanks. However, most stormwater infrastructure is designed for probable peak events, and the size of the infrastructure may have to be maintained if peak events occur when rainwater tanks are already full.⁹

Modelling indicates that the amount of water diverted into rainwater tanks in Sydney during the top 10 peak rainfall events in the last 100 years varies greatly, from 1-3% for some roof area/tank size combinations up to 50% for large tanks connected to smaller roof areas. Results for other cities are also varied.

MJA (2007) also noted that:

If significant volumes of rainfall could be diverted from the stormwater system, local drains in greenfield sites could potentially be reduced in size, however larger drains and drains capturing significant road or other run-off would be affected to a lesser degree.

The potential impact on the stormwater system will be greatest in greenfield sites and will vary significantly amongst cities. A marginal impact analysis would require a detailed engineering analysis of stormwater costs in each location and is beyond the scope of this study. A review of the literature reveals a lack of published information on the marginal cost of stormwater systems. One paper by Coombes and Kuzcera (2003) suggested that for a particular development in Newcastle, stormwater savings could be in the order of \$959 per lot, with ongoing savings of \$10-23 per year. In another development, savings were estimated at from \$210 to \$511 per lot, however it is unclear from the paper how the figures were derived.

Another impact on stormwater infrastructure will be the reduction of nutrients in the system, which will have the greatest impact when water drains into environmentally sensitive areas. Melbourne Water estimates that rainwater tanks reduce the flow of nitrogen into waterways by around 0.2 kg per year for a 150m² roof. Developers are currently levied a one-off offset charge of \$800/kg of nitrogen, who can therefore save around \$160/house by installing

⁹ MJA (2007), pp. 31-32

rainwater tanks. This saving should probably be regarded as cost reflective and applied to developers as a broader infrastructure saving for Melbourne residents.¹⁰

¹⁰ MJA (2007), pp. 32-33

3. Adding environmental costs to levelised costs

Question Two: What are the additional costs and benefits of environmental externalities - in particular the impact of reducing greenhouse gas emissions and the costs of carbon abatement?

The cost comparison of the previous section compares the financial costs of different water source options in high rainfall capital cities, levelised per unit of water produced. However, a full economic analysis would take account of the relative environmental impacts of differing water source options, such as:

- ecosystem impacts of inundation associated with dam construction;
- the environmental impact of materials used in construction and installation (including the materials used to manufacture rainwater tanks);
- environmental impacts of hyper-saline outflows caused by desalinating sea water; and
- greenhouse gas impacts of all water source options, as they all involve some energy use (except gravity fed outdoor garden use of rainwater tanks).

In many cases, demand-management (reduction in the water used per capita) has a very low environmental impact and in some cases can also reduce energy use. For example, water-efficient showerheads not only reduce water consumption but also reduce the energy used to produce hot water, so in turn reduce greenhouse gas emissions. However, initiatives such as high-level water restrictions can cause amenity costs to gardeners, which can have real flow-on effects (for example, on health impacts).¹¹

Dam construction is associated with inundation of large tracts of land, with the most suitable sites for dam construction usually chosen first. Historically, the most suitable sites have been determined by geography, prioritising high yield, and low construction and delivery cost. More recently, environmental and social impacts form part of the decision-making process, however in many cases, large-scale inundation will continue to have substantial environmental impacts through alteration of the natural landscape. While noting this, measurement of these impacts is beyond the scope of this study.

Desalination of seawater is the most energy-intensive of the water source options explored here and involves the release of hyper-saline water as a by-product. Environmental impacts are assessed as part of the water source planning process, however MJA is unaware of any attempt to measure this impact in cost/benefit terms in the Australian context.

Rainwater tanks do not have notable environmental impacts associated with their ongoing use, however they do consume energy associated with pumping for internal use. Given the

¹¹ Gardening being a favoured physical activity of older Australians, for example.

much smaller distances the water is moved, energy costs per kilolitre are typically lower than other source options, except where water is gravity fed throughout the system.

While measurement in dollar terms of the environmental impacts described above is beyond the scope of this study, recent initiatives to put a price to greenhouse gas emissions allows us to factor this environmental impact into our cost analysis.

3.1. The cost of carbon

The European Union has established a trading market in carbon emissions, providing a cap in total emissions and allowing trading within that total. The price of carbon in the European Union Emission Trading Scheme (EU ETS) was 0.98 Euro per tonne (AUD \$1.65)¹² as at 27 February 2007, down from over 30 Euros in April 2006.

While Australia currently does not have a national carbon trading market, New South Wales has the Greenhouse Gas Abatement Scheme (GGAS), imposing mandatory greenhouse gas benchmarks on all NSW electricity retailers and certain other parties (referred to as benchmark participants) to abate the emission of greenhouse gases from the consumption of electricity in NSW. The price of NSW Greenhouse Gas Abatement Certificates (NGACs) is not publicly released, however MJA understands that the average price in June 2005 was \$12.65 per tonne (1 certificate being equal to one tonne of carbon).¹³ In the National Electricity Market, one tonne of carbon emissions is roughly equal to one megawatt hour of electricity.¹⁴

Sydney Water has announced that its planned desalination plant will be 'effectively' powered using renewable energy.¹⁵ Using Sydney Water estimations of energy use (900 GWh annually) and estimated cost of 'greenhouse gas offsets' (\$35m annually), this results in an estimated cost per tonne of carbon of \$37.18/t. This estimate is greater than the NGAC price quoted above, and more likely reflects the price of purchasing renewable energy (through Renewable Energy Certificates) rather than offsetting carbon emissions (for example, producing wind energy as opposed to investing in carbon sinks).

Again, the spot price of Renewable Energy Certificates is not publicly released, however reports have noted an oversupply in 2006 and a subsequent decrease in price to around \$23/t.¹⁶ Table 4 below models the water source options from Table 3 with publicly available estimates of energy use, carbon emissions and abatement costs per ML at different carbon prices. As can be seen from the table, rainwater tanks have the lowest abatement costs of the sources explored.

¹² Exchange rate of AUD\$1 = 0.593 Euro (13 March 2007)

¹³ http://www.edl.com.au/PublicDocuments/20050825_ENEJune2005FinRes&BusUpdate_254303.pdf

¹⁴ 1.03t CO₂e/MWH as at February 2007.

¹⁵ <http://www.sydneywater.com.au/EnsuringTheFuture/Desalination/pdf/ProjectReportOperation.pdf#Page=1>

¹⁶ <http://www.renewableenergyaccess.com/rea/news/story?id=47634&src=rss>

Table 4: Costs of abatement of alternative sources – Sydney and SEQ

Water Source	Annual yield (ML/a)	Energy use (MWh/a)	Energy efficiency (MWh/ML)	CO ² emissions (t)	Abatement costs \$/ML		
					NGAC \$12.65/t	REC low \$23/t	REC high \$37.18/t
Rainwater tank Sydney	0.07	0.067	0.956	0.07	12	22	36
Desalination (125 ML/day)	45,625	225,000	4.932	235,350	62	113	183
Desalination (500 ML/day)	182,500	900,000	4.932	941,399	62	113	183
South East Queensland							
Traveston Dam Stage 1	70,000	137,480	1.964	143,804	25	45	73
Traveston Dam Stage 2	40,000	52,920	1.323	55,354	17	30	49
Traveston Dam Stage 3	40,000	52,920	1.323	55,354	17	30	49
Tugan Desalination	45,000	225,000	5.000	235,350	63	115	186

Source: MJA analysis, energy estimates from ISF/Cardno 2007.

Table 5 explores the impact of carbon abatement on the relative levelised costs for different water sources. While the impact on rainwater tanks is the lowest of all options, in no cases do the relative levelised costs change due to carbon abatement. The overall small impact on levelised cost of abating the carbon released through water production, or purchasing carbon neutral energy for this production, suggests that this is an affordable option to water suppliers.

Table 5: Carbon impacts on levelised costs of alternative sources – NSW and QLD

Water Source	Original levelised cost (\$/kl)	Change in levelised cost		
		NGAC \$12.65/t	REC low \$23/t	REC high \$37.18/t
Sydney				
Rainwater tank	2.15-5.41	0.01	0.02	0.04
Desalination (125 ML/day)	1.80 +	-0.13	-0.07	-
Desalination (500 ML/day)	1.80 +	-0.13	-0.07	-
South East Queensland				
Rainwater tank	2.22-6.22	0.01	0.02	0.04
Traveston Stage 1	} 2.00+	0.03	0.05	0.07
SEQ Desalination		0.06	0.12	0.19

Source: MJA analysis.

Carbon abatement has the highest impact on desalination, which is the most energy intensive. It should be noted that Sydney Water's levelised cost estimates factored in carbon abatement at the highest estimated cost of our analysis (\$37.18/t), so cheaper abatement would decrease their levelised cost.

4. Deferring alternative water sources with rainwater tanks

Question Three: How many rainwater tanks would be required to avoid or defer dams and desalination plants such as those proposed for Sydney and South East Queensland?

As noted in the previous sections, the annual yield of rainwater tanks varies according to a number of elements. Estimates of average yield in different cities are therefore heavily dependent on assumptions about these elements, especially rainfall and average roof collection area. In this section, we first consider the potential yield from a rainwater tank roll-out programme compared with the yield from other proposed dams and desalination plants, and then discuss the potential impact on the timing of future water sources.

Potential Yield from Rainwater Tank roll-out

MJA analysis of ABS Census and housing approvals data reveals that the maximum number of houses currently suitable for rainwater tank use (i.e. detached and semi-detached houses)¹⁷ in South East Queensland is around 859,900 and in Sydney is 1,127,500.¹⁸ The actual number of properties suitable for installing a tank could be substantially below this maximum once site specific factors such as available land area and plumbing constraints are taken into account. The maximum number of houses that are ‘in-scope’ in Sydney is around 70 per cent, and in SEQ more broadly it is 78 per cent of total housing stock (Table 6). The ABS reports that the uptake of rainwater tanks in capital cities, is small, with 4.9 per cent in Sydney, 4.8 per cent in Brisbane and 6 per cent in Melbourne. This contrasts with Adelaide where 37.8 per cent of households had a rainwater tank in 2004.¹⁹

¹⁷ The ABS identifies ‘semi-detached’ houses (11% and 6.6% of total houses in Sydney and SEQ respectively in 2001) as including some row, terrace and town houses, which may be less suitable for rainwater tanks. However, MJA notes that Gold Coast City Council includes as mandatory rainwater tanks on all new ‘...such dwellings as stand alone single dwellings, duplexes, row houses, terrace houses, town houses and villa units’. (Gold Coast City Council, 2007: p1).

¹⁸ Based on census data for 2001 and building approvals data to 2006 (Cat 8731.0, 3236.0).

¹⁹ ABS. 2004. Environmental Issues: People’s Views and Practices. Cat 4602.0.

Table 6: Potential rainwater tank households 2006 – Sydney and SEQ

<i>Water Source</i>	<i>Sydney</i>	<i>SEQ</i>
<i>Total households 2006</i>	1,610,800	1,104,647
<i>Total potential RWT households 2006</i>	1,127,519	859,907
<i>Ratio of potential RWT households to total households 2006</i>	70%	78%

Source : ABS, Qld Govt, MJA analysis²⁰

The yield from a rainwater tank roll-out programme will be constrained by the number of suitable sites. Given the broad band of yield per rainwater tank found in Figure 1, MJA does not consider a point estimate of yield to be a realistic approach without modelling based on multiple weather stations and detailed information on roof collection areas. As such, when estimating the potential yield from rainwater tanks, MJA provides a number of alternatives relative to yield assumptions. These assumptions are found in Table 7.

The equivalent number of rainwater tanks for the full capacity yield of a 500ML/day desalination plant in Sydney would be 3.65 million at a yield of 50kL/a, 2.6 million at 70kL/a, and 1.8 million at 100kL/day.

Stage 1 of Traveston Dam at sustainable yield would require 1.4 million rainwater tanks at 50kL/a, 1 million at 70kL/a, or 700,000 at 100kL/a.

Results are summarised in Table 7.

Table 7: Alternative Sources: Number of rainwater tanks for equivalent yield, Sydney and SEQ

<i>Water Source</i>	<i>Total annual yield (ML/a)</i>	<i>Number of rainwater tanks for equivalent yield</i>		
		<i>50kL/a</i>	<i>70kL/a</i>	<i>100kL/a</i>
<i>Sydney Desalination (125 ML/day)</i>	45,625	912,500	651,786	456,250
<i>Sydney Desalination (500 ML/day)</i>	182,500	3,650,000	2,607,143	1,825,000
<i>Traveston Dam Stage 1</i>	70,000	1,400,000	1,000,000	700,000
<i>Wyaralong Dam</i>	18,000	360,000	257,143	180,000
<i>Gold Coast Desalination</i>	45,000	900,000	642,857	450,000
<i>Max number of houses 'in scope' SYD - 2006</i>			1,127,519	
<i>Max number of houses 'in scope' SEQ - 2006</i>			859,907	

Source : MJA analysis

²⁰ 2001 data from ABS Census, household growth 2001-06 from ABS Cat 8731.0, SEQ total household data from Qld Govt 2007. See Table 8 for detailed analysis

Take-up scenarios

The analysis of the previous section identified the equivalent yield of various dams and desalination plants compared with rainwater tanks. In some cases, the number of tanks is in excess of the number of 'in scope' properties. However, rainwater tanks effectively defer the need for new water sources by reducing the demand on existing water supplies and 'freeing up' capacity that can then be used to supply growth rather than constructing new water sources.

MJA understands that it is unlikely that rainwater tanks would be capable of being installed within the required timeframe, or provide sufficient security, to avoid the immediate drought response needs of South East Queensland (such as the construction of the Western Corridor Recycled Water Scheme). However, longer term water supply solutions targeting future growth could potentially be deferred if rainwater tanks adequately reduce the draw on existing water sources.

Contrary to expectations, existing houses in Sydney and especially in SEQ have large potential for take-up of rainwater tanks when compared with future growth in dwellings in greenfields sites. While new dwellings can be designed to be 'rainwater tank-friendly', a growing proportion of future dwellings are expected to be in high density unit blocks which are mostly unsuitable for rainwater tanks (although the majority of new dwellings since 2001 have been detached 'rainwater tank-friendly' dwellings).

The majority of existing dwellings in Sydney and especially SEQ are detached houses, making them suitable in theory for rainwater tanks. While there has been a trend in recent years for larger houses on smaller blocks, these do not constitute the majority of houses in SEQ. Indeed, older houses are more likely to sit on a property with a larger backyard with available space for a rainwater tank. Furthermore, the classic 'Queenslander' house sits on stilts and typically has more space underneath to sit a rainwater tank.

However, existing dwellings are likely to prove more expensive to connect to rainwater tanks (especially when plumbed for internal use), and the roofing may be designed awkwardly for rainwater capture. It is clear that not every detached or semi-detached house is suited for tank capture, and it is likely that connection will be more costly for these houses than in greenfields sites.

Regardless, the generous rebates being offered in SEQ (up to \$1,700 per tank with \$100 more if plumbed internally) are clearly motivating many homeowners to purchase a tank, with 500 rebates a week being granted by Brisbane City Council at the time of writing (which is an annual rate of 26,000) and reports of waiting periods of 6 months for some tanks.²¹ The small rebate for plumbing costs may account for the small proportion of rebates going to tanks being plumbed internally (around 5 per cent). Also, tightening water restrictions are clearly motivating homeowners to use rainwater on their gardens.

MJA has seen no study into the potential for rainwater tank take-up in SEQ or Sydney and makes no claim to this in this paper. However, there appears no major physical impediment for take-up in the majority of existing dwellings, and a number of policy options exist should

²¹ Pers comm. Brisbane City Council, 23 March 2007.

this be deemed an economically viable objective, from larger rebates to more compulsory policies.²² Where internal plumbing is impractical, external use is clearly attractive in SEQ (with 95 per cent of rebates going to external use). SEQ also has high outdoor water use compared with other capital cities and therefore limiting rainwater tanks to outdoor use reduces annual yield by only around 15% (compared with tanks plumbed for both indoor and outdoor use, based on a 5kL tank and 125m² roof collection area).

MJA provides a number of illustrative scenarios for take up, found in Figure 3 and Figure 4. These scenarios demonstrate the impact on expected annual demand of a take-up of rainwater tanks of 5 per cent of houses per year, up to different threshold points. A maximum of 10 per cent is considered by industry to be substantial, however MJA have modelled a number of scenarios between this figure and the maximum conceivable take-up ('Max take-up').

For Sydney, 'BAU less 40%' models 'business as usual' demand based on ABS household projections, less an assumed 40 per cent reflecting the maximum impact of BASIX water savings targets on new dwellings.²³ All lines below this demonstrate take-up of rainwater tanks in existing homes at 5 per cent per year, to thresholds at 10 per cent, 25 per cent, 50 per cent, and the maximum potential take-up.


As we concern ourselves with the potential for rainwater tank rollout on *existing* dwellings, and the 'BAU less 40%' assumes a reduction of 40 per cent of demand from *future* dwellings, there is no double-counting in this analysis.

The overlaid arrow demonstrates the potential to defer expenditure on water source infrastructure that would otherwise have been constructed in 2010 (for illustration only). Water sources could potentially be deferred by more than the indicated time if demand management initiatives reduce future demand, or may be deferred by less than the time indicated due to other factors such as the need for emergency water supplies or specific regional growth requirements.

²² Regarding the potential for mandating rainwater tanks on all suitable houses, MJA notes that both NSW and QLD currently mandate rainwater tanks for all suitable new houses.

²³ BASIX is described in more detail below


Figure 3: Annual demand impact of different rainwater tank take-up schedules - Sydney

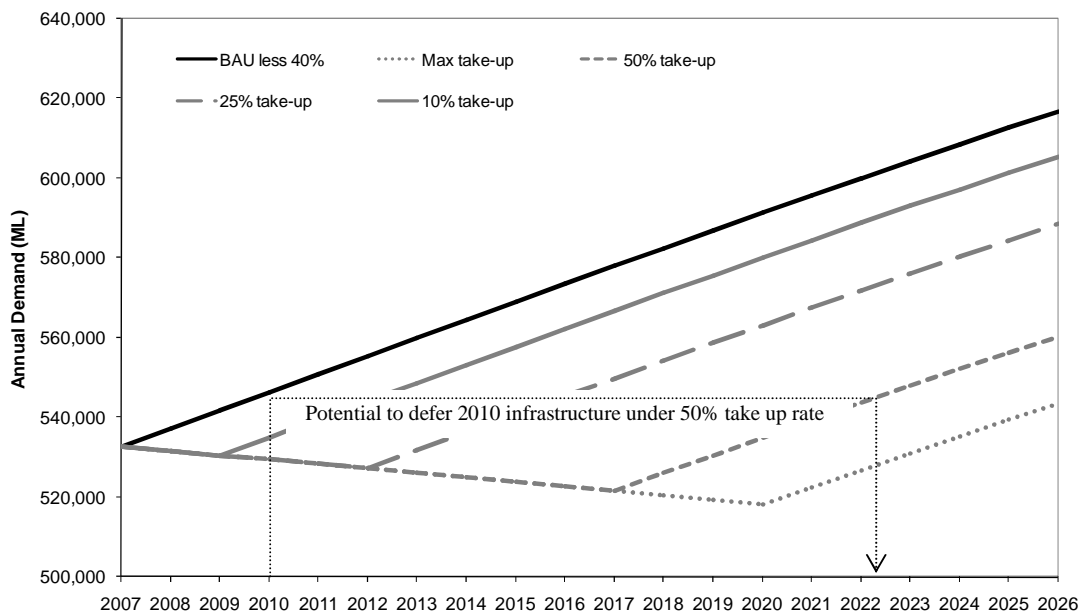

Source: MJA analysis

Figure 4 reflects these same take-up scenarios in SEQ, using the ‘adopted demand’ scenario from the Queensland Government’s paper ‘Water for South East Queensland: A long term solution’. This is based on a medium savings scenario which assumes rainwater tanks on all new developments, but an ‘ultimate penetration of 5% of existing accounts’ (Qld Govt, 2006: p16). As current penetration is already at 5 per cent, MJA identifies no double-counting, and regardless provides a number of take-up scenarios.

Figure 4: Annual demand impact of different rainwater tank take-up schedules - SEQ

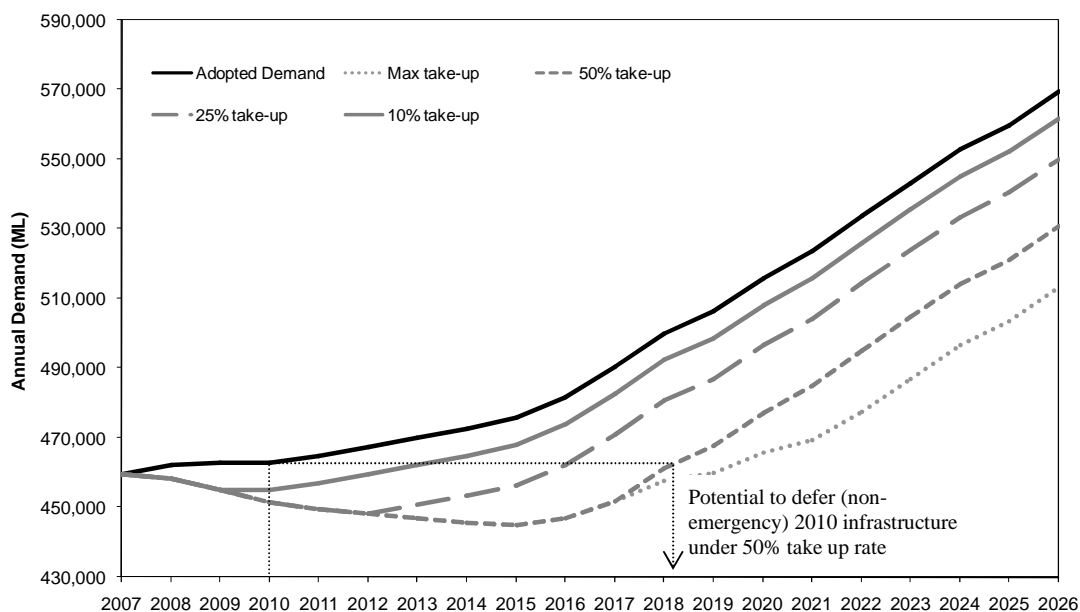

Source: MJA analysis, DNRMW (2006)

Future housing growth to 2026 is expected to be associated with a higher proportion of rainwater tanks than there are currently, given new regulations in NSW and QLD.

Based on the estimates of demand shown in the charts above, the impact of rainwater tank take up on new water infrastructure can also be estimated. In most cases, the precise timing of future water sources is unknown. In the case of Sydney, the existing metropolitan Water Plan estimates that a major new water source may not be required for 10 years or more if adequate demand management and recycling initiatives are in place. However the NSW government has indicated that a desalination plant will act as a contingency measure if water supplies fall below certain critical levels.

While the exact timing of new sources is unknown, MJA has illustrated the impact of rolling out rainwater tanks to 5% of households each year, assuming that Sydney demand were 40% less than “Business As Usual” (due to demand management, as above) and the SEQ demand matched the case adopted by the Queensland Government. In this scenario, expenditure in 2010 that was required to cater for demand growth across the system (excluding emergency supply options) could potentially be delayed:

- past 2026 in Sydney or to 2019 in SEQ if all potential housing (i.e. detached or semi-detached houses – 70 per cent of Sydney dwellings and 78 per cent of SEQ dwellings) could install a rainwater tank;
- to 2022 in Sydney or to 2018 in SEQ if only 50% of total dwellings could install a rainwater tank;
- to 2012 in Sydney or 2013 in SEQ if only 10% of total dwellings could install a rainwater tank;

BASIX requirements in NSW

As of 1 October 2006, all new residential dwellings as well as all residential alterations and additions throughout NSW are required to satisfy BASIX requirements. These requirements relate to energy and water efficiency, and can be met flexibly, including through the optional use of rainwater tanks. However, it appears that rainwater tanks are effectively mandatory because it seems difficult to satisfy the alternative water supply requirements without one, even though different options are available, including the use of groundwater or recycled water.

BASIX sets energy and water reduction targets for new homes and apartments. The Water target ranges from 40% to 0% across NSW, taking into account the significant variances in the climate. Key points are:

- 90% of new residential development will be covered by the 40% water target.
- No new home built in NSW will use more water than the current state average.
- The areas covered by the 40% target represent 98% of the state's population growth.

The BASIX website provides examples of how to meet water targets in different areas of the state.

A BASIX fact sheet states: BASIX is subject to ongoing monitoring: since implementation, the Department has conducted a monitoring program of 100 BASIX-compliant home designs that are now in the development approval and construction process. Items to note:

Every home has a rainwater tank, the average size being 4,000 litres and the majority of which will be plumbed to the toilet and laundry, as well as providing water for the garden.

Building requirements in SE Queensland

New water savings targets set by the Queensland State Government will apply to building development applications lodged for the construction of new houses in South East Queensland from 1 January 2007 and state-wide from 1 July 2007.²⁴ The new targets can be achieved through a number of options including household rainwater tanks or alternatives such as dual reticulation, communal rainwater tanks or storm water reuse (most of which are less attractive options than rainwater tanks).

There are minimum requirements in place if rainwater tanks are used to meet the water savings targets. These are:

- single detached houses must install a rainwater tank with a minimum 5000L capacity;

²⁴ http://www.lgp.qld.gov.au/docs/building_codes/housing/water-saving/faq.pdf

- non-detached houses, such as town houses and terrace houses, must install a rainwater tank with a minimum 3000L capacity;
- rainwater tanks must receive rainfall from at least one half of the roof catchment area or 100m², whichever is the lesser;
- rainwater tanks must supply water for external use and internal use to toilet cisterns and washing machine cold water taps;
- internal fixtures supplied from a rainwater tank must have a continuous supply of water, which may be achieved by an automatic switching device or a trickle top up system.

The potential for future growth in rainwater tanks associated with current building requirements is thus quite strong. It appears that the vast majority of appropriate dwellings in NSW will attach a rainwater tank as part of their BASIX requirements, and the same appears to be true for QLD. In terms of dwelling growth, however, South East Queensland appears to have higher relative potential for rainwater tank growth than Sydney, due to the types of dwellings being constructed there.

MJA is aware of no published projections of dwelling type to 2026 or beyond. However, there has been a trend towards higher density living in recent years, and this trend can be expected to continue in the future as the scope for greenfields developments decreases. This will reduce the potential for rainwater tanks in future housing growth over time, bringing us back to the substantial potential for rainwater tanks in the existing housing stock.

The proportion of recent household growth in Sydney and SEQ which could potentially use a rainwater tank (RWT households) is found in Table 8.²⁵ For Sydney it is just over 50 per cent, and for Brisbane it is closer to 75 per cent. This reflects the growth in high density housing in Sydney. MJA is unable to predict the housing composition of future growth, however Sydney is expected to grow 450,00 houses to 2026 while SEQ grows almost 600,000. It is likely that the growth in potential RWT households as a proportion of total growth will slow. If, for example, future growth in households is 50 per cent 'rainwater tank-friendly', this will grow 225,000 rainwater tanks in Sydney, and 296,500 in SEQ.

²⁵ Detached, semi-detached, row, terrace and town house

Table 8: Housing growth 2006-2026, Sydney and SEQ

<i>Water Source</i>	<i>Sydney</i>	<i>SEQ</i>
<i>Households 2006</i>	1,610,800	1,104,647
<i>Growth in potential RWT households as proportion of total growth 2001-06</i>	52%	74%
<i>Total potential RWT households 2006</i>	1,127,519	859,907
<i>Total household growth 2006-2026</i>	449,500	593,027
<i>Total households 2026</i>	2,060,300	1,697,674
<i>If growth 2006-2026 is 50% potential RWT households</i>	224,750	296,514

Source : ABS, MJA analysis²⁶

²⁶ 2001 data from ABS Census, household growth 2001-06 from ABS Cat 8731.0, household projections 2006-2026 from ABS Cat 3236.0, SEQ growth data based on medium population growth projections from Qld Govt and average household size estimations. Rainwater tank projections for SEQ based on Brisbane housing approvals data 2001-06 (ABS Cat 8731.0)

5. Cost of rolling out rainwater tanks

Question Four: What would be the cost to Government of a targeted program to roll out rainwater tanks to 5% of households each year in high rainfall cities such as Sydney and Brisbane?

As outlined above, State Governments across Australia have legislation and regulation focussing on attaching rainwater tanks to new housing and renovations. However, MJA has identified that a significant proportion of existing households could make use of rainwater tanks, but currently do not and will be largely untouched by existing policy. As such, there is scope to expand the number of existing households with rainwater tanks.

Table 9: Cost of rolling out rainwater tanks, Sydney and SEQ

	Sydney	SEQ
Total households 2006	1,610,800	1,104,647
5% of households	80,540	55,232
'In scope' RWT households 2006	1,127,519	859,907
Proportion of current households with rainwater tanks	5%	5%
Proportion of 'in scope' RWT households but without RWTs	65%	73%
Number of 'in scope' RWT households but without RWTs	1,046,979	804,675
Max years available for excess take-up of rainwater tanks	13.0	14.6
Approx ave cost of 5kL rainwater tanks	\$2,500- \$3,500	\$2,500- \$3,500
Total annual capital cost of 5% roll-out of rainwater tanks (\$m)	\$200-280	\$140-200
Annual water savings (low) ML / RWT / a	3,800	2,300
Annual water savings (high) ML / RWT / a	8,500	5,500

Source : ABS, MJA analysis²⁷

Given the scope for potential take-up of rainwater tanks in existing households, MJA estimates that if rolled out to 5 per cent of total households per year and *all* potential households were capable of installing tanks, households without a tank would be exhausted in 13 to 15 years. Table 9 shows that, assuming a capital cost of \$2,500-3,500 per rainwater tank and an average yield of 70kL/a, roll-out would extend annually to:

²⁷ 2001 data from ABS Census, household growth 2001-06 from ABS Cat 8731.0, household projections 2006-2026 from ABS Cat 3236.0, SEQ growth data based on medium population growth projections from Qld Govt and average household size estimations. Rainwater tank projections for SEQ based on Brisbane housing approvals data 2001-06 (ABS Cat 8731.0)

- over 80,540 households in Sydney at an annual capital cost of \$200-\$280 million, saving 3.8-8.5 GL/year per 5 per cent of houses; and
- 55,232 households in South East Queensland at an annual capital cost of \$140-\$200m, saving 2.3-5.5 GL/year per 5 per cent of houses.

The cost of developing and implementing policies to enact this rollout would be in excess of these figures. However, flexibility in application of the policy could see some rainwater tanks being installed externally only, with substantial installation savings (but lower average yields). Any policy installing such a high number of tanks per year would be expected to attract a capital savings through bulk purchase and installation.

6. References

Department of Natural Resources, Mines and Water (DNRMW). 2006. *Water for South East Queensland: A long-term solution*. August 2006

D-G 2006: NSW Department of Planning. 2006. *Major Project Assessment, Kurnell Desalination Plant and Associated Infrastructure: Director-General's Environmental Assessment Report Section 75I of the Environmental Planning and Assessment Act 1979*, NSW Department of Planning, September.

Gold Coast City Council. 2007. Planning Scheme Policies, Policy 20, Rainwater Tanks. January 2007. Accessed 28 March 2007.

<http://www.goldcoast.qld.gov.au/attachment/goldcoastwater/RainwaterTanksPolicy20.pdf>

Institute for Sustainable Futures. 2006. Stuart White, David Campbell, Damien Giurco, Caroline Snelling, Alex Kazaglis, Simon Fane, Amir Deen and Jason Martin. 2006. *Review of the Metropolitan Water Plan: Final Report*, Institute for Sustainable Futures, Sydney, ACIL Tasman and SMEC Australia, April.

Institute for Sustainable Futures and Cardno. 2007. Turner, A., Hausler, G., Carrard, N., Kazaglis, A., White, S., Hughes, A. and Johnson, T. 2007. *Review of Water Supply-Demand Options for South East Queensland*, Institute for Sustainable Futures, Sydney and Cardno, Brisbane, February.

Marsden Jacob Associates (MJA). 2006. *Securing Australia's Urban Water Supplies* (prepared for the Department of Prime Minister and Cabinet)

Marsden Jacob Associates (MJA). 2007. *The Cost-effectiveness of Rainwater Tanks in Urban Australia* (commissioned by the National Water Commission, currently unpublished - references used with their permission)

Queensland Government. 2007. Household projections – Queensland Local Government Areas 2007. Department of Local Government, Planning, Sport and Recreation.

Sydney Water 2006a: Sydney Water. 2006. *Preferred Project Report for Sydney's Desalination Project*, Sydney Water.

Sydney Water 2006b: Sydney Water. 2006. *Water Conservation and Recycling Implementation Report 2005-2006*, Sydney Water.